
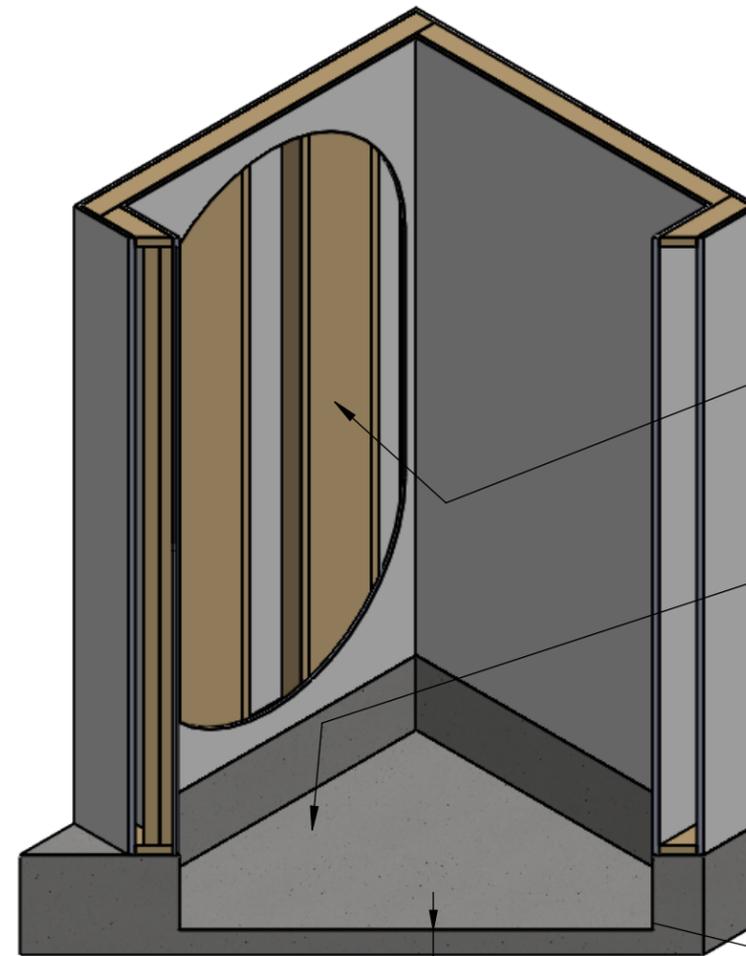



| Specifications | |
|-------------------------|-------|
| Concrete PSI | 3,000 |
| Min Pit Floor Thickness | 4.00 |

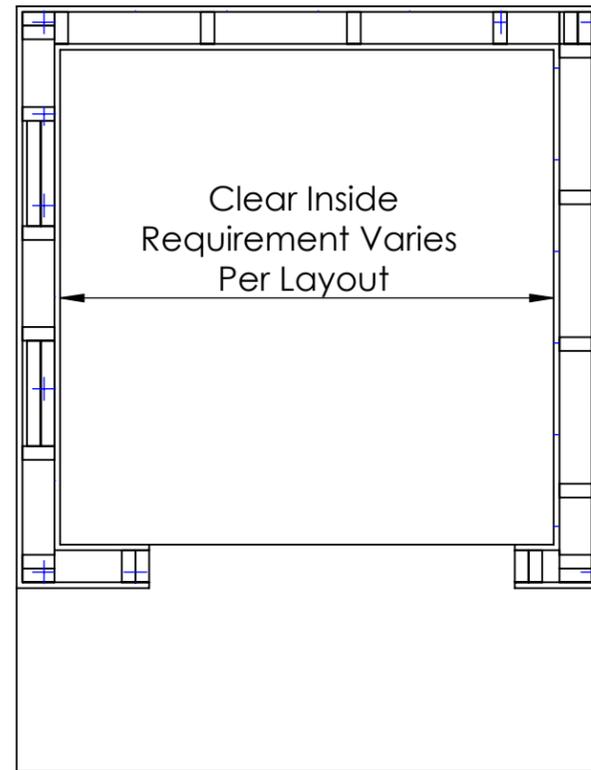

4.00 MIN
SLAB
THICKNESS

MUST SUPPORT
MIN 400LBS OF
PULL OUT FORCE

MUST SUPPORT
MIN 2200LBS OF
DOWNWARD FORCE

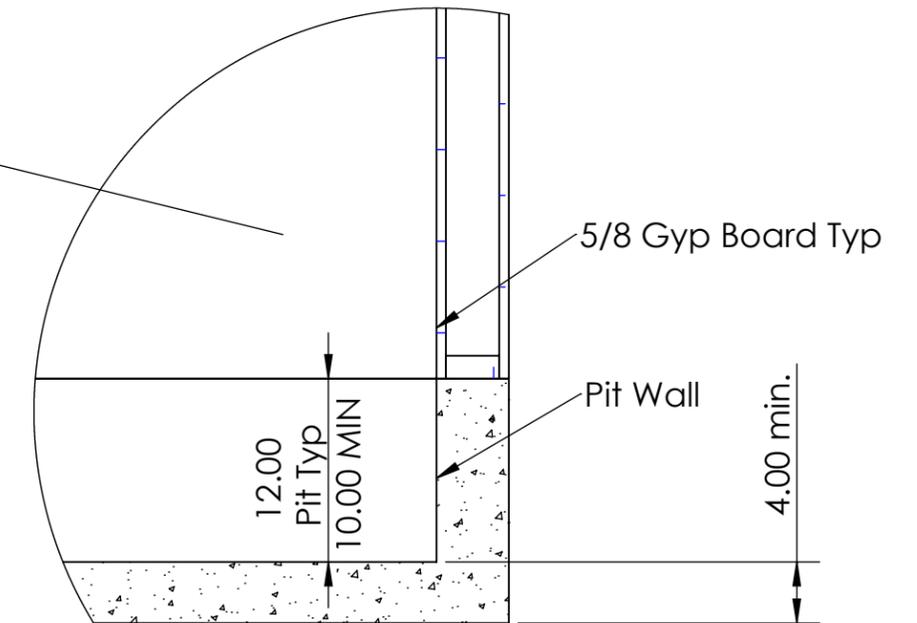

| | | | |
|----------------------|--|----------|--------------------------------|
| DO NOT SCALE DRAWING | NAME | DATE | PROJECT NAME |
| | DRAWN | KSB | 6-5-18 |
| APPROVAL STATUS: | PROPRIETARY AND CONFIDENTIAL | | PROJECT LOCATION |
| APPROVED | THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF PRECISION LIFT INDUSTRIES, LLC. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF PRECISION LIFT INDUSTRIES, LLC IS PROHIBITED. | | COMMENTS: Pit Detail |
| APPROVED AS NOTED | | | |
| REVISE AND RESUBMIT | | | |
| SIGNATURE | SIZE | DWG. NO. | REV. |
| | A | | |
| | SCALE 1:16 | | SHEET 1 OF 1 |